Rev - 1	
Rev - 2	

ELECTRICAL CONTRACTOR TO PROVIDE

- ALL CONDUIT AS DETAILED
- 20 AMP SERVICE TO TELLER AREA, AS SHOWN
- 117 VAC SERVICE, 20 AMP SERVICE TO EACH CUSTOMER UNIT (17 AMP FULL LOAD)
- CONDUIT "C" IS FOR LOW VOLTAGE CONTROL CABLES INSTALLED BY TUBE SUPPLIER - ELECTRICAL CONTRACTOR TO PROVIDE PULL WIRES IN EACH CONDUIT

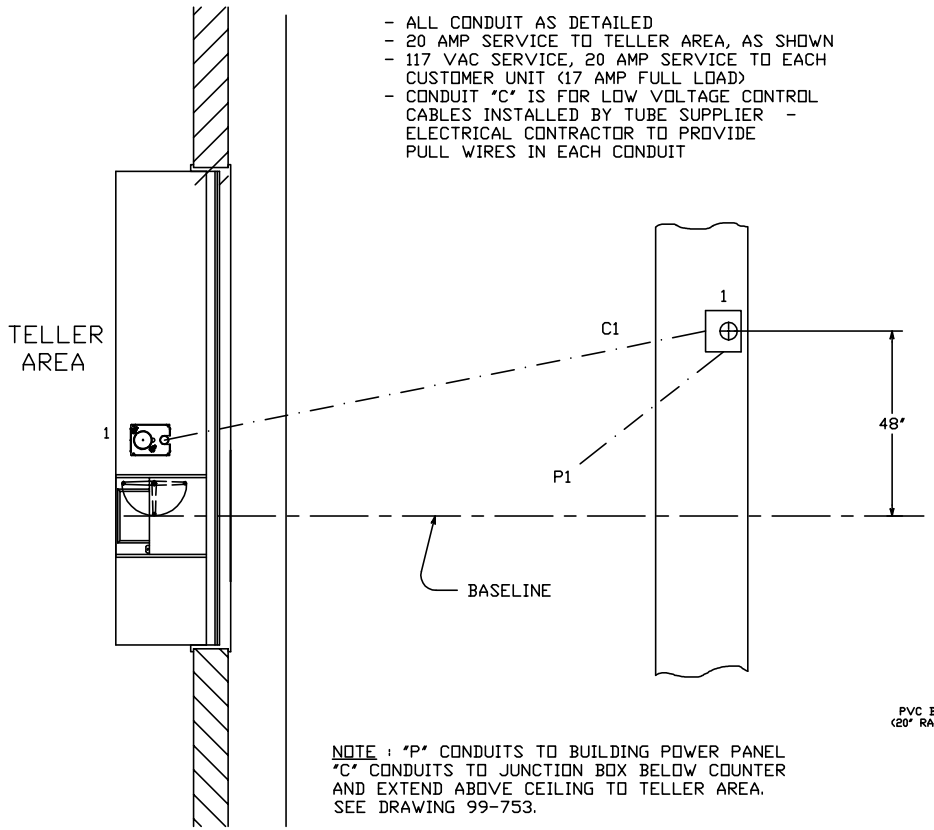

NOTE : "P" CONDUITS TO BUILDING POWER PANEL
"C" CONDUITS TO JUNCTION BOX BELOW COUNTER AND EXTEND ABOVE CEILING TO TELLER AREA. SEE DRAWING 99-753.

PLAN

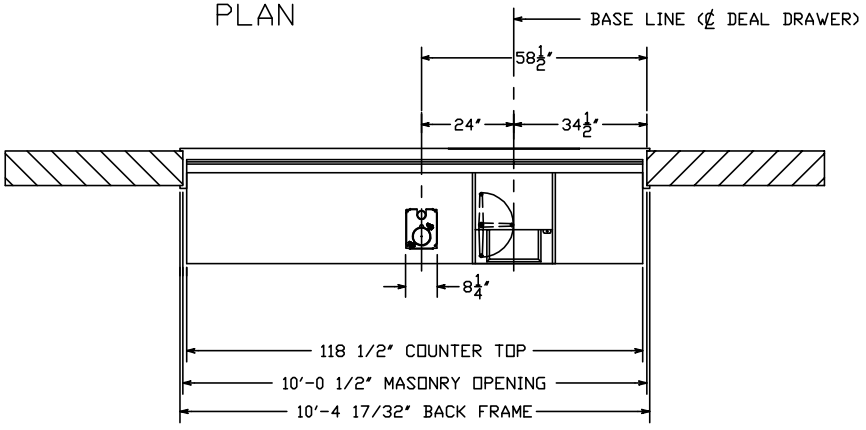

PLAN - INTERIOR

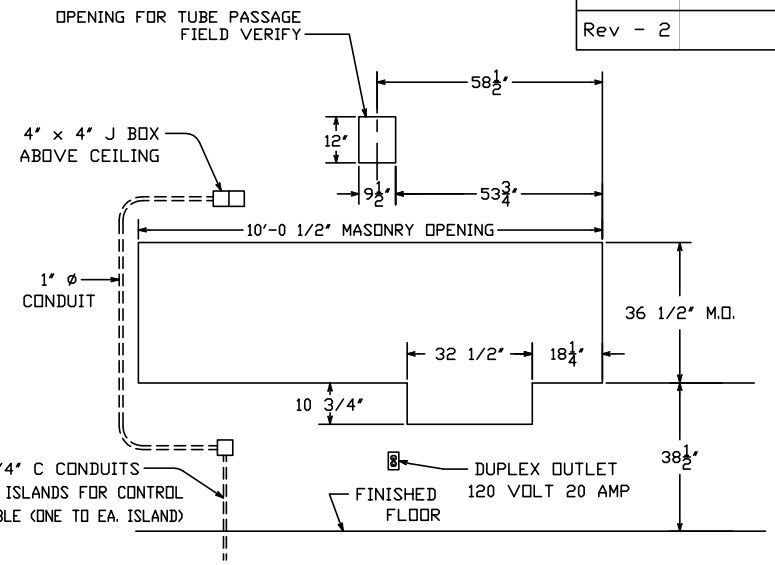

MASONRY DETAIL

(FOR MODEL 310D U.L. WINDOW)

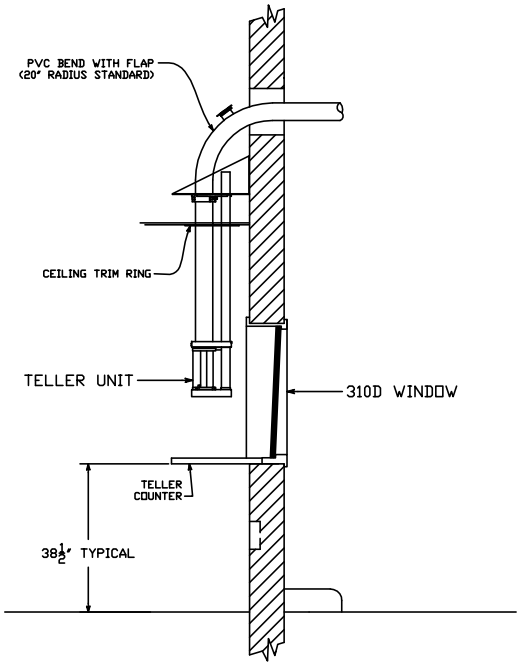

SECTION

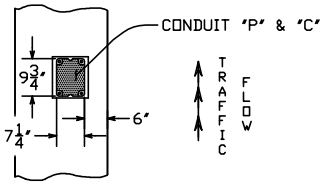

ISLAND DETAIL

(ALSO SEE DWG. 99-754)

REFERENCE DRAWING NUMBER # 95-696; 99-754 ; 99-915

HAMILTON AIR

MODEL HA-45
112 SYSTEM - UPSEND INTERIOR
DETAILS with 310D

Drawing Number : 99-1102	Date : 9/23/11